


FIGURE 1: Correlation of test data on dry chemical application rates required to extinguish liquid hydrocarbon spill & dike fires.

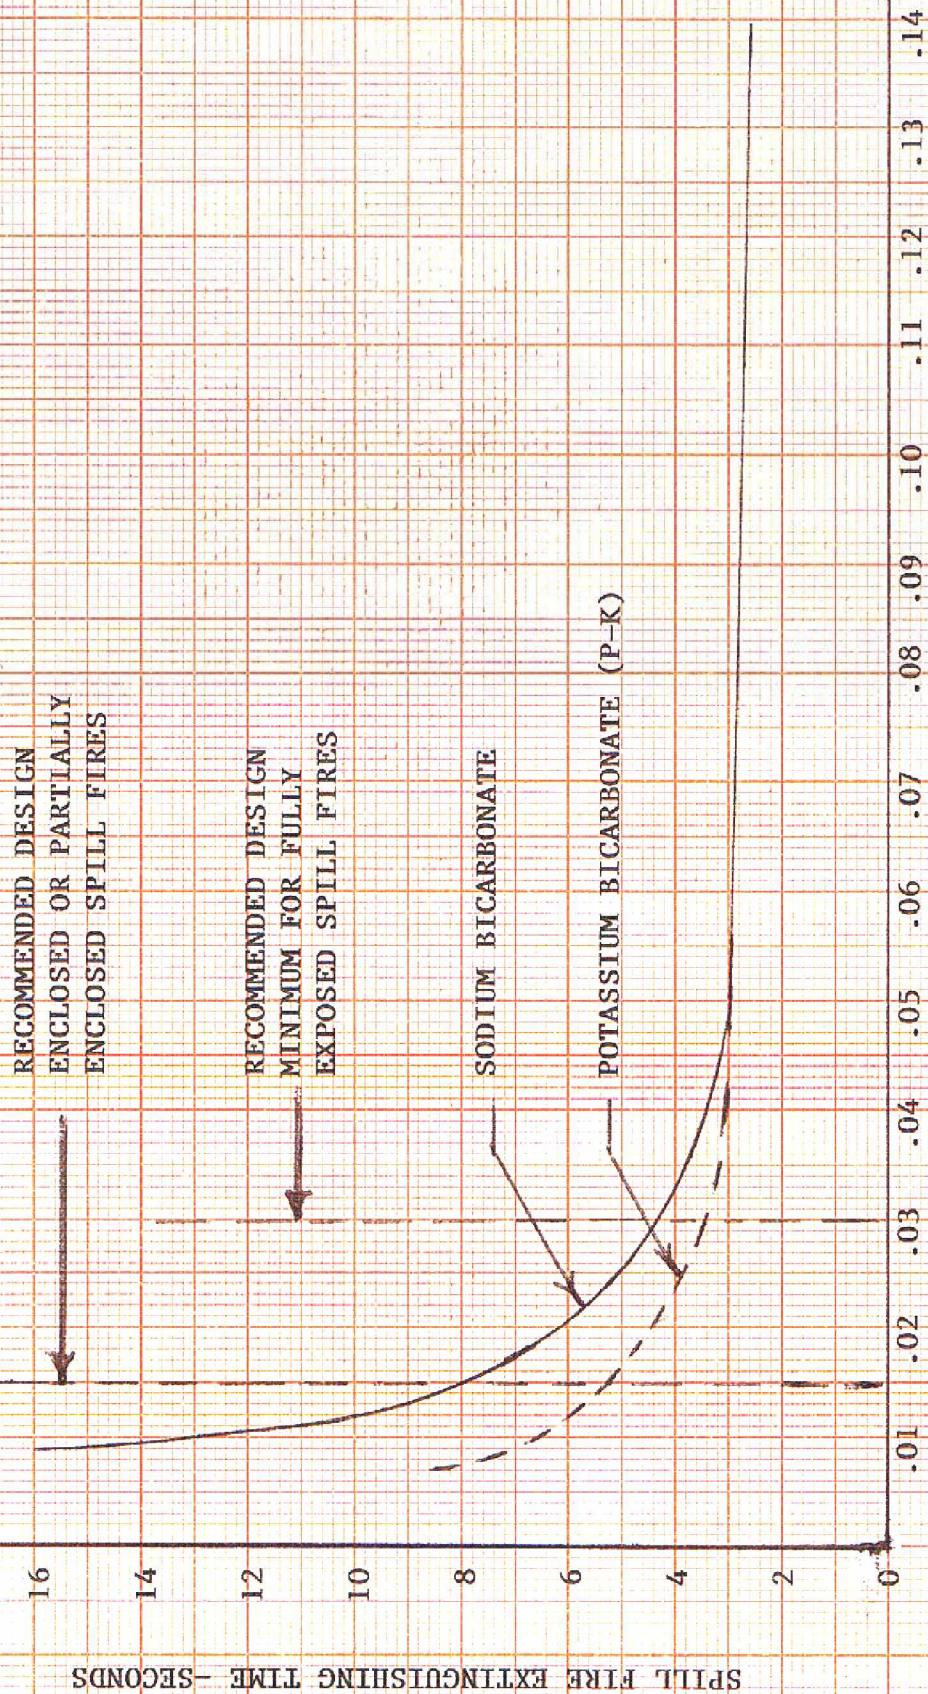

DRY CHEMICAL APPLICATION RATE - LBS. PER SECOND PER SQ. FT. OF FIRE SURFACE AREA